

MWT18J6

45 lb. (20 kg) Capacity Rigid-Mount Washer-Extractor Specification Sheet



milnor.com



STANDARD FEATURES:

- 6 speeds (2 wash, 1 distribution, 3 extract)
- E-P Plus® programmable controller
- Single-motor inverter drive
- Tall, lifting ribs
- Sealed ball bearings
- High M.A.F. (Mechanical Action Factor)
- Large cylinder perforations
- Fresh-water flushing chemical manifold
- Auto tension V-belt drive
- Five (5) liquid chemical injection ports
- Control reads in English/second language
- 5-year limited warranty on frame, cylinder & shell



OPTIONAL FEATURES:

- Lint trap
- Mounting base

Why Purchase Milnor?

BENEFIT: Saves linen replacement costs. Faster process times reduce fabric wear, promoting longer linen life!

BENEFIT: Greater mechanical action (M.A.F.) leads to better wash quality. Greater cylinder perforated area, tall rib construction and precise cylinder speeds generate better cleaning results, better rinsing, and better extraction.

BENEFIT: Better extraction saves dryer fuel. 90-G high extract provides excellent moisture removal. Lower extract speeds are available for uniforms, delicate textiles and blended fabrics.

BENEFIT: Fewer operator errors. E-P Plus® controller with back-lit LCD display allows operator to choose formulas from real words, not codes. Standard controller features English/Spanish (other languages optional). Controller also provides diagnostic and error messages, shortening training time of new employees.


BENEFIT: Faster repairs mean less downtime. Superior product support through local, skilled dealers.



Superior cylinder design



Safe chemical injection



Solid industrial frame

Contact Milnor for your local, authorized dealer:

PELLERIN MILNOR CORPORATION

P.O. Box 400, Kenner, LA 70063 • t: 504-467-9591 • milnorinfo@milnor.com

MWT18J6






45 lb. (20 kg) Capacity Rigid-Mount Washer-Extractor Specification Sheet



milnor.com

LEGEND

C	Cold water inlet, .75" (19 mm) GHT
D	Drain, 3" (76 mm) ID hose
E	Electrical connection
F	Foundation pads, anchor bolt holes .8125" (21 mm) diameter
G	Hot water inlet for soap chute
H	Hot water inlet, .75" (19 mm) GHT
L1	Soap chute
L2	Liquid supply inlets

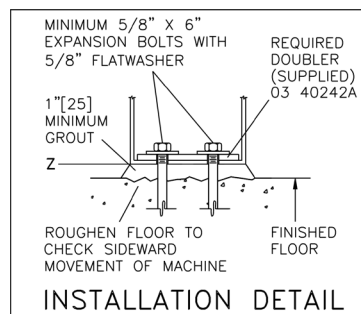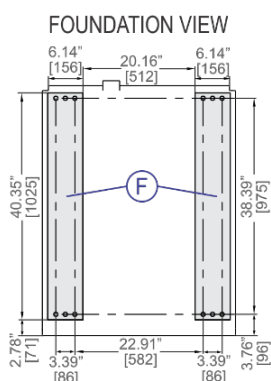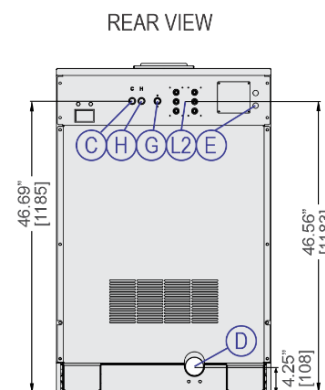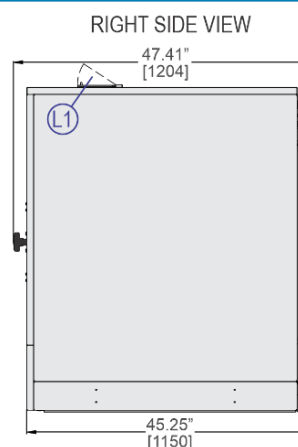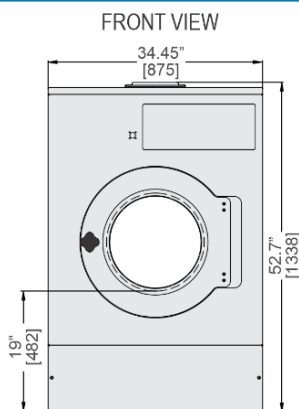

FLOOR REQUIREMENT 6" MINIMUM.

RECOMMENDED



MECHANICAL SPECIFICATIONS

Capacity – lb. (kg)	45 (20)
Cylinder Diameter x Depth – in. (mm)	27.56 x 18.43 (700 x 468)
Cylinder Volume – cu. ft. (L)	6.36 (180)
Door Opening – in. (mm)	15.70 (399)
Machine Dimensions (W x D x H) – in. (mm)	34.45 x 47.41 x 52.70 (875 x 1204 x 1338)
Shipping Dimensions (W x D x H) – in. (mm)	40.35 x 50.79 x 58.19 (1025 x 1290 x 1478)
Motor – HP (kW)	3 (2.2)
Wash Speed – RPM	39
Distribution Speed – RPM	71
Extraction Speed – RPM	620
Extraction G-Force	150
Static Weight – lb. (kg)◆	1293 (587)
Max. Dynamic Load RMS – lb. (kg)◆	1350 (614)
Frequency - Hz◆	10.3
Water Pressure (Required) – psi (bar)	10-75 (.68-5.1)
Water Valve - Cv Rating at 72°F (22°C)	0.68-0.72 (2.57-2.73)
Minimum Recommended Distance Between Machines – in. (mm)	0

ELECTRICAL SPECIFICATIONS

Voltage	Running Amps	Fuse (Amps)	Circuit Breaker (Amps)
220/3/50	5	FRN15	15
208, 240/1/60	7, 6	FRN20	20
208, 240/3/60	5, 4	FRN15	15
380/3/50-60	3.5	FRS8	15
480/3/60	3	FRS5	15

See Fuse and Wire Size manual MAEFUSE1BE for safety information. Contact factory regarding single phase availability.

▲ See dimensional drawing for complete details.

◆ It is the sole responsibility of the owner/user to assure that the floor and/ or any other supporting structure exceeds not only all applicable building codes, but also that the floor and/ or any other supporting structure for each washer-extractor or group of washer-extractors has sufficient strength and rigidity (i.e., a natural or resonant frequency many times greater than the rotational machine speed with a reasonable factory of safety) to support the weight of all the fully loaded machine(s) including the weight of the water and goods, and including the published 360° rotating sinusoidal RMS forces that are transmitted by the machine(s). Contact the factory for additional machine data for use by a structural engineer.

■ Machine bases made from concrete should either be part of a monolithic pour or should be tied into foundation and not isolated from existing floor.